


DERWENT LONDON

The Johnson Building

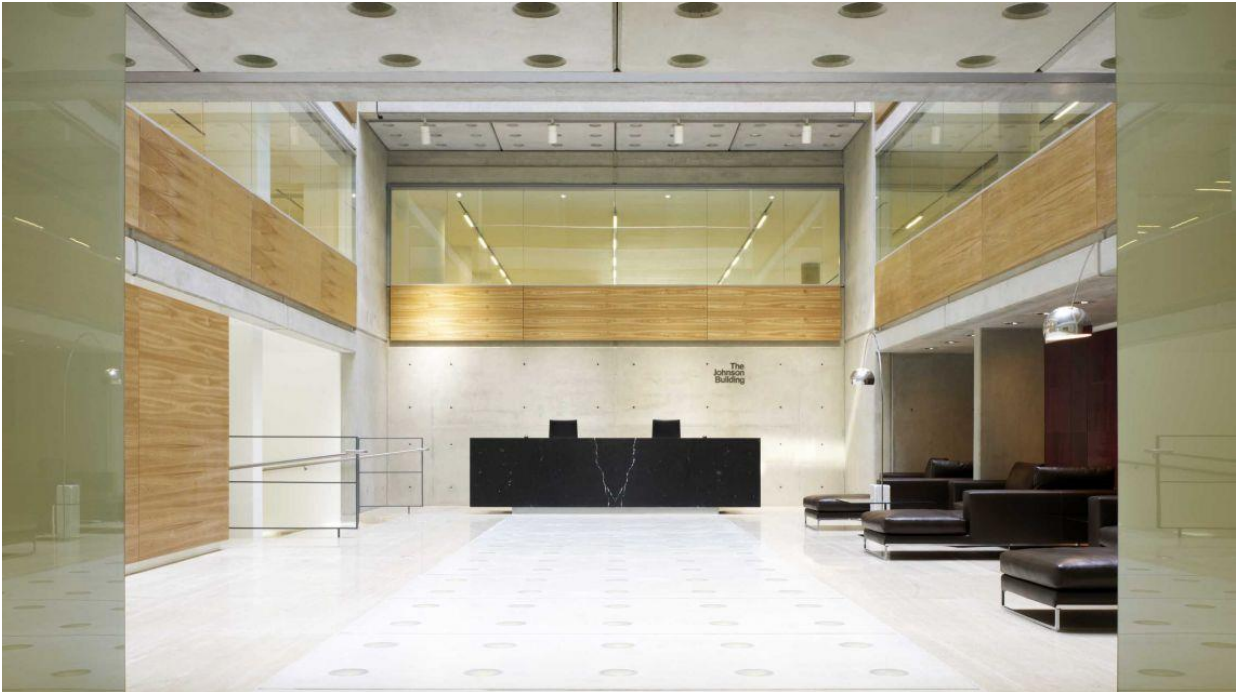

Fire Evacuation Procedures

Contents

- 1.0 Introduction
- 2.0 Means of Escape in Case of Fire
- 3.0 Means for Giving Warning in Case of Fire
- 4.0 Means for Fighting Fire
- 5.0 Discovering a Fire
- 6.0 Evacuation Procedure
- 7.0 Assistance to Emergency Services
- 8.0 Procedures for Persons Working Out of Normal Hours
- 9.0 Fire watch contingency plan
- 10.0 Building Fire Staircase Location Plan

1.0 Introduction

When a fire breaks out in a building in, which people are present, the primary need is for those people to be able to escape safely and quickly. Special experience and knowledge are needed to plan in advance what the escape routes should be and how they should be protected and equipped so that they will remain effective in an emergency for as long as necessary.

Being prepared will greatly reduce the likelihood of the fire emergency procedures not being effectively carried out. It is vital at all times that you are prepared.

This building is provided with reception and security staff, a comprehensive fire alarm system, trained fire wardens, competent management and a Health & Safety Management System with a Fire Risk Assessment carried out each year. It is therefore considered that this building is classed as a 'Managed Building'.

Every person in the **Johnson Building** should be aware of the following, with responsible persons needing to be prepared in their additional areas as indicated below.

The requirement of The Regulatory Reform Order 2005 (Fire Safety) (RRO), which came into force 1st October 2006.

The order has introduced radical and wide-ranging reforms to fire safety legislation in England and Wales. The legislative regime applies to most non-domestic properties and requires "A Responsible Person" – defined in the case of a workplace as the Employer to the extent that the workplace is under his control and is to carry out a "Fire Risk Assessment" to ensure that the more detailed fire safety requirements of the RRO are being met. As well as an "Alterations Notice" a Fire Inspector (as defined in the RRO),

A FIRE INSPECTOR CAN ISSUE ENFORCEMENT AND PROHIBITION NOTICES AS THEY DEEM NECESSARY.

1.1 All Persons

General Fire Prevention

Know what action is to be taken on discovering a fire.

Know where to find fire fighting equipment and fire alarm call points.

Know how to use an extinguisher.

Know the layout of your floor.

Know your escape routes.

Know your assembly point.

Know what action is to be taken on hearing the fire alarm.

Know your floor wardens and their deputies.

Look after and escort your visitors and contractors to the assembly area.

Tenants are responsible for ensuring that the correct frequency of fire training is carried out and are recorded for audit purposes.

Each employee is to receive fire training with practical exercises where possible.

- 1. On induction training.**
- 2. On an annual basis there after.**
- 3. The Landlord will conduct a Fire Evacuation Drill every six (6) months.**

The Landlord undertakes an annual Fire Risk Assessment for the building which includes all areas where the Landlord has responsibility (Plant Rooms, Common Area etc); this is to assess the impact on the remainder of premises.

Tenants are responsible for their own demise and are required to have competent person carry out a Fire Risk Assessment of their areas of responsibility. Any "Significant Findings" arising out of the Fire Risk Assessment **must be** communicated to the Landlord.

On majority request the Landlord will provide Fire Warden Training once a year.

Landlord is responsible for the servicing of the;

Landlord area fire extinguishers
Common area emergency lighting
Dry Risers
All the fire alarm system

2.0 Means of Escape In Case Of Fire

2.1 Introduction

Means of escape in case of fire can be defined as “structural route” forming an integral part of the building whereby persons can escape from fire by their own unaided efforts to a place of “Ultimate” Safety or “Comparative” Safety’.

For example, if a person leaves the building from any level and exits direct to open air, then they are in a place of “Ultimate” safety. However, if entering a staircase from an upper floor of offices and the staircase is enclosed by fire resisting doors it is a place of “Comparatively” Safety until they exit into the open air.

2.2 Details and Description

Details & description are contained in the Buildings Fire Risk Assessment.

The escape routes are indicated with the appropriate Safe Condition 'Fire Exit' signage (Green & White Running Man) and emergency lighting is provided which will come on automatically in the event of an electrical power failure.

The system illuminates all stairways, exit routes and directional signs and changes to floor levels, to enable persons to leave the premises without assistance from normal lighting.

The assembly point available for the building is:

The Pedestrian area on the Corner of Leather Lane and Greville Street.



3.0 Means for Giving Warning in Case of Fire

3.1 Introduction

In any building, which is used as a workplace there should be a means of giving warning in the event of a fire. Therefore a fire alarm should be provided to give warning to persons in case of fire in the building. This can be a manually operated system, which consists of break glass call points located at entrances onto the main fire exit routes, or in larger buildings automatic detection systems are fitted throughout to detect fire & smoke.

3.2 Details and Description

Fire Alarm System

The Main Fire Panel is Located in the reception entrance foyer, with six (6) Slave Panels which can be found in the following Floors:

One on the Ground Floor
Two located of 1st Floor
One on the 2nd Floor
Two on the 5th Floor

The fire alarm system within the building is a multi-zone multi-loop system covering the whole building.

The Johnson building has been fitted with a Wireless State of the Art fire detection system which can be activated, either by breaking the glass cover on one of the red call points or automatically when a smoke/heat detector is triggered.

The red call point units are located adjacent to the fire exit doors leading to the stairways and in some of the corridors; in addition there are red call points within the tenant's demised areas.

The system is fully automatic, if there is an activation of a Smoke/Heat Detector, there is a 180 Second (3 Minute) Delay on the system allowing staff to investigate any false alarms to reduce Business Interruption. Staff identify 1st activation by way of local alarm and strobe light at the main reception desk.

However, if two Smoke/Heat Detector Heads are activated then the alarm will go into 'Full' alarm and sound (continuous warbling siren) on all floors, all Lifts will go to the ground floor and the Lift doors will open, the Plant is automatically shut down, the Runways to the Lift Lobbies will open and the doors either side of the Revolving Doors will open.

If within the 180 second delay it is found to be a false alarm, then the system will be reset and the alarm will not sound, however if the reason why the system went into alarm is not found within the 180 seconds then the system goes into "Full" alarm in the area of activation and the roof plant area. i.e. 2nd Floor **and** Roof Plant Area.

All Lifts will return to the ground floor and the Lift doors will open, all Plant is automatically shut down, the Runways to the Lift Lobbies will open and the doors either side of the Revolving Doors will open.

The remainder of the building will **not go** into alarm. There will be a further 180 Second (3 Minute) Delay on the system allowing staff to investigate further, if it is found to be a false alarm within the 2nd 180 Second Delay then the system will be reset and the alarm will not sound in the remainder of the building. (The Building Management Team will bring personnel that have evacuated back into the building)

Fire Safety Management Plan

Johnson Building, 77 Hatton Garden, EC1N 8JS.

However if it cannot be found within the 2nd 180 Second Delay then the remainder of the Building goes into "Full" alarm and all other personnel will evacuate under the guidance of their own Fire Wardens.

Personnel must only evacuate their floor when the alarm is activated on their floor.

PLEASE NOTE that Langdales and EAT have a Hard Wired System which is linked into Johnson Building's main Fire Panel.

PLEASE NOTE Langdales and EAT **DO NOT** have a delay and the Alarm will sound immediately in the event of a Smoke/Heat Detector Head being activated in these areas.

The fire alarm system is powered from the mains through a separate main switch-fuse. A secondary source of power is by way of batteries continuously charged by an AC mains operated charger which in the event of a mains failure will continue to operate the system.

The fire alarm is tested on a weekly basis @ **11:00 am** each **Friday** morning to test its operational effectiveness. Should any defects or issues be observed during the test please notify the reception on: 020 7831 0056.

4.0 Means for Fighting Fire

4.1 Introduction

Under The Regulatory Reform Order 2005 (Fire Safety) (RRO), it is a requirement, where people are employed to work, to provide a means for fighting fire. This includes portable fire fighting equipment.

4.2 Dry Risers

The Johnson Building is fitted with two dry risers which serve every floor of the building. The purpose of a dry riser system is to enable the Fire Brigade to pump high pressure water into the riser, thus allowing them to draw on the supply wherever it may be needed within the building.

These are located in Staircase's 2 and 3 (North and South respectively). The Fire Brigade will be directed to these areas upon arrival.

4.3 Smoke Ventilation System

When the Fire Alarm System is activated smoke vents will open on each floor landing of Staircase 2. This will draw any smoke out of this stair area allowing for a safer evacuation. The manual override control panel for this system is located next to the Fire Panel.

4.4 Safe Haven / Refuge Intercom System

The **Johnson Building** is fitted with a fully integrated Safe Haven / Refuge Intercom System. These are located on every staircase landing, throughout the whole building and will protect the occupiers from smoke and flame for up to an hour. They are intended for use by non ambulant persons or persons who are unable to evacuate the building via the staircases. It allows for persons in the Safe Havens / Refuge areas to communicate with the Fire Brigade via the reception.

4.5 Fire Resisting Doors

The doors: -

- 1 Office doors and ones which open onto the fire escape stairways at all levels that are signed with a blue disk, marked "Fire Door Keep Shut"
- 2 To cupboards, plant rooms and service riser ducts in the tenanted and common parts, and which are signed "Fire Door Keep Locked"

These are fire-resisting doors and should either be kept shut or locked. They should not be wedged or held open in any way. If they are, or if they do not close into the doorframe correctly, please report the fact to reception.

This requirement is to ensure that, in the event of a fire, the fire escape routes from the upper floors of the building, i.e. the fire escape stairways, are protected from smoke and flame, enabling employees and visitors to safely make their escape, and to prevent fire spreading from floor to floor.

4.6 Portable Fire Fighting Equipment

Portable fire extinguishers are provided by the Landlord in all Plant Rooms, Back of House Corridors, Reception Area and Building Managers Office. Each extinguisher has a label on it that describes its method of operation and the type of fire it can be used to extinguish.

Types of Fire Extinguishers used in the Johnson Building.

There uses and their colour coding according to **BS EN 3: 1999**

The contents of an extinguisher are indicated by a coloured zone on the body of the extinguisher.



<u>Type</u>	<u>Used on the following</u>
Water	Carbon based fires involving paper, wood, cloth, etc.
Foam	Electrical, Flammable liquids and flammable gases.
Carbon Dioxide	Flammable liquids, petrol etc and other fires where use of water would be dangerous

You should make yourself aware of the location of this equipment, its method of operation and the type of fire each is suitable to extinguish, so that in the event of a fire you do not have to search for one.

Fire Extinguishers within the tenant's demise are the tenant responsibility and should be serviced annually.

5.0 Discovering a Fire

5.1 All Persons

If you discover a fire you should follow the steps outlined below.



Fire Action

If you discover a fire



Operate the nearest fire alarm point.



Call the Fire Brigade by telephoning 999 and state there is a FIRE at Johnson Building, 77 Hatton Garden, EC1N 8JS.



Leave the building by the nearest safe exit.



Report directly to the assembly point at The Pedestrian area on the Corner of Leather Lane and Greville Street.



- Do not stop to collect personal belongings.
- Do not use lifts.

In case of Fire;

1. Operate the nearest call point.
2. Fight the fire, if safe and trained to do so.
3. Leave the building by the nearest safe route
4. Do not stop to collect belongings
5. Do not use the lifts
6. Proceed to the assembly area.

The assembly point available for the building is:

The Pedestrian area on the Corner of Leather Lane and Greville Street.



6.0 Evacuation Procedure

On hearing the fire alarm sound, the following should be carried out:

6.1 All Persons

- Must evacuate the building by the nearest available safe escape route. If you have visitors or contractors with you, instruct them to follow you.
- Close doors & windows without causing delay.
- **DO NOT STOP TO COLLECT PERSONAL BELONGINGS**
- Leave the building by calmly walking to the assembly point, never run.
- **DO NOT RE-ENTER THE BUILDING UNTIL INSTRUCTED TO DO SO.**

6.2 Once an evacuation has started the procedure must be completed. This is to prevent accidents by the merging of persons going out and persons going back in.

6.3 DISABLED PERSONS

- Disabled persons must be escorted to the relevant **assembly area** with a 'Buddy'.
- Disabled persons must not be left alone.

REGARDING EVACUATION OF DISABLED PEOPLE

Be aware of the specific needs of the Disabled Persons and Persons with Impaired Mobility, Vision and Hearing; be aware that each individual will have different needs due to the varying levels of Disability and Impairment.

Wheelchair Users and Persons with Impaired Mobility

Wheelchair Users and Persons with Impaired Mobility should have an identified "Buddy" and they should be moved along the specific escape routes to the identified refuge point (Or a landing on a protected fire stair) Do not attempt to lift the wheelchair or occupant unless you have been specifically trained to do so. All tenants are responsible for their own Disabled Staff, Staff with Impaired Mobility & their Visitors with Disabilities and Impaired Mobility. In addition they must carry out a Personal Emergency Evacuation Plan (PEEP) for each individual. Do not use the lifts unless there is a designated Fireman's Lift.

People with Impaired Vision

Look out for the people who may be disoriented. Tell them your name and speak clearly giving them instructions. Use your arm to lead them through the evacuation route identified by the green & white running man. Provide continuous commentary as to where you are going. If you have Employees or Visitors within your demise with Impaired Vision then they also must have a "Buddy". In addition they must carry out a Personal Emergency Evacuation Plan (PEEP) for each individual (This must be recorded for the Audit Process). Do not point as these gestures will go unnoticed.

People with Impaired Hearing

These people may not have heard the alarm. Attract their attention some way or another and ensure that they follow the evacuation route identified by the running man. All tenants are responsible for their own Staff with Impaired Hearing & their Visitors with Impaired Hearing. In addition they must carry out a Personal Emergency Evacuation Plan (PEEP) for each individual. There will be 10 impaired hearing alarm pagers held on the main reception desk. All visitors with impaired hearing should pick one of these up when they enter and book into the building.

6.4 Receptionists

- Ensure a 'current company visitor evacuation list's is available'.

6.5 Reception / Concierge / Security Officers / Building Manager (Incident Controller)

- On hearing the fire alarm call the Fire Brigade, 'don' your Hi Visibility Vests/Jackets and take up the following duties.
- Ensure that the "Emergency Pack" (The Red Ruck Sack) is collected and taken to the assembly point.
- The reception, security & Concierge / assist with the evacuation and guide people to the Assembly area (**Pedestrian Area on the corner of Leather Lane and Greville Street**).
- The Buildings Manager is to hold access keys, know location of plant areas, riser cupboards, location of any Hazchem etc and meet the Senior Fire Officer at the reception on their arrival.
- The Reception / Concierge / Security representative will obtain the results of the evacuation from the Company Fire Marshals at the assembly area and report them to the Incident Controller. The Incident Controller will obtain results of the evacuation and relay any pertinent information to the Fire Officer.
- Ensure any disabled register is current and monitor safe haven refuge intercom panel.
- Prevent unauthorised entry.

6.6 Fire Warden Duties

On hearing the evacuation fire alarm:-

- The reception will call 999 in consultation with The Building Manager (Or Deputy)
- Ensure that all persons (including visitors and contractors) in your area evacuate by the nearest available escape route immediately.
- Check your area, including toilets, meeting and store rooms to ensure that all personnel under your care have evacuated.
- Do not take personal risks through delay.
- Proceed to the assembly point and await further instructions
- Report to the Reception staff at the assembly point and make your report. e.g." *Fire Warden of Walker Media 6th floor north. All areas clear*".

7.0 Assistance to Emergency Services

7.1 Building Manager / Building Engineer / Out Of Hours Security

- Ensure all keys are available which could provide access to other areas such as switch rooms, gas shut off valves and plant enclosures.
- Provide relevant plans of the affected area.
- Provide precise details as to the location and status of the emergency.
- Provide details of the location and type of any fire fighting appliances and dry risers, if asked.
- Provide the location of fire alarm reset panel, etc.
- Provide details of all specialist and emergency engineers who may be called to provide assistance with plant.
- Remember that in an emergency situation, the Senior Fire Officer will assume **Absolute Authority** until the emergency is over.

8.0 Procedures for Persons Working Out of Normal Hours

7pm – 7am Monday to Friday Saturdays and Sundays 24 hours

- 8.1** Out of hours persons remaining at work are to inform building reception of their direct phone number. Building reception will therefore know who is present in the event of activation of the fire alarm. All persons are required to respond to the fire alarm by evacuating to the assembly point. Persons evacuating must then report to Security staff at the assembly point informing them that they have vacated.
- 8.2** If Security staff at the assembly point do not receive confirmation that occupied areas have been vacated, this will be reported to the fire brigade on arrival.
- 8.3** Once at the assembly point, await further instructions from Security.

9.0 FIRE WATCH CONTINGENCY PLAN – Johnson Building, 77 Hatton Garden, EC1N 8JS.

If for any reason the fire system is taken out of service in your area or suffers a system failure, then a Fire Watch Plan must be implemented. This must also be recorded for Audit Purposes.

A. Action to be taken on discovering a Fire:-

1. In case of fire the warden is to raise the alarm by activating the nearest fire alarm system call point and shout **FIRE. FIRE. FIRE.** Notify Reception/Security of the fire.

WORD OF MOUTH, FIRE ALARM or AIR KLAXON HORN MAY RAISE THE ALARM

2. If the fire is considered small enough to be easily and safely extinguished (i.e. a waste paper bin fire) attempt to put the fire out with the nearest correct type of extinguisher, but **Do Not** take personal risks.

ONLY ATTEMPT TO EXTINGUISH A FIRE IF IT IS SAFE TO DO SO AND YOU HAVE A CLEAR ESCAPE ROUTE AWAY FROM THE FIRE.

3. Never attempt to fight large fires.
4. From the floor of the incident the tenant would:
 - Inform Reception / Security – **Telephone: 020 7831 0056**
5. Inform the other floors in their demise by either or all the following:
 - Activation of a fire alarm call point
 - Shout FIRE. FIRE. FIRE.
 - Sound the Klaxon horns
 - Phone

Security to immediately inform other tenants Receptions and nominated fire wardens on each floor. And ring the **Fire Brigade**

6. Normal evacuation procedures come into play.
7. If the fire is considered too large, or if it should get out of control or an escape route is threatened, leave the building quickly and calmly by the nearest available escape route. Wherever possible, assist in the evacuating visitors. **DO NOT** stop to collect personal belongings.
 - Information to be given: Name and address of the premises.
 - Any missing persons
 - Location and type of fire
 - Location and involvement of hazardous materials
9. Report to the fire assembly area. Fire wardens to check that their area of the building has been evacuated and report this to the nominated person(s).

B Evacuation Procedures

If you hear the fire alarm or other warning, leave the building in a calm and orderly fashion using the nearest fire exit and report to the pre-determined assembly points.

IF YOU CAN.

Switch off any machinery.
Close all doors behind you.
Close windows behind you.

DO NOT.

Use the lifts.
Delay departure by gathering personal belongings.

FIRE STAIRCASE LOCATION PLAN

